
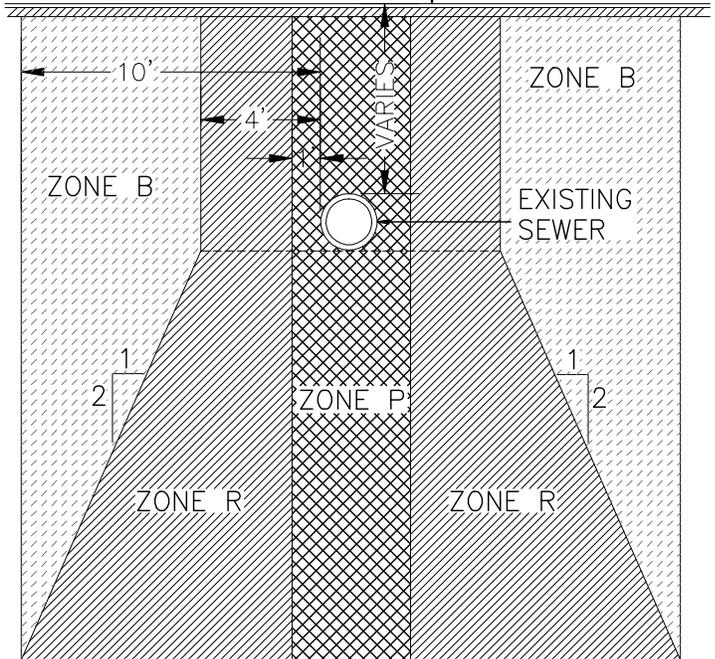


EXISTING SEWER—NEW WATER MAIN

GROUND SURFACE

GROUND SURFACE

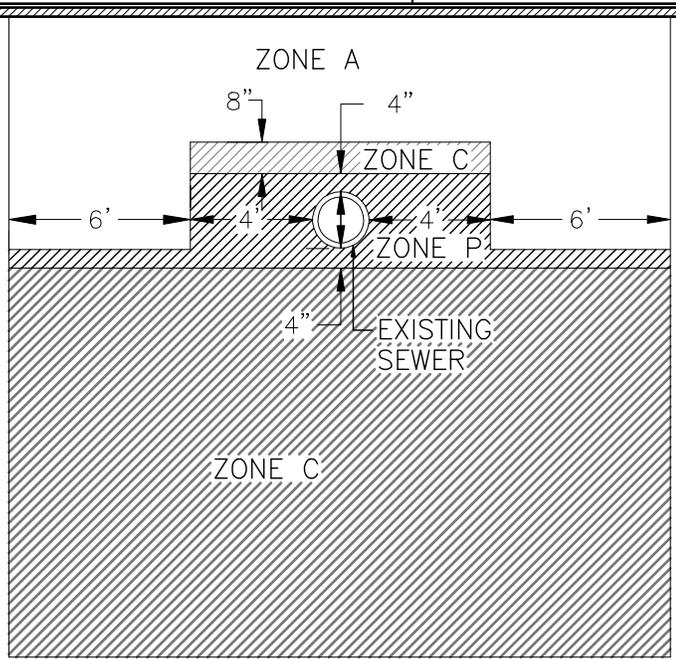

PERPENDICULAR CONSTRUCTION

PARALLEL CONSTRUCTION

ZONE	CONSTRUCTION REQUIREMENTS
A 	NO SPECIAL REQUIREMENTS.
B 	THE WATER MAIN SHALL BE CLASS 200 PIPE.
C 	THE WATER MAIN SHALL BE APPROVED CLASS 200 PLASTIC PIPE CONFORMING TO DR 14 PER AWWA C900 OR D.I. CL350 PIPE WITH HOT DIP BITUMINOUS COATING. THERE SHALL BE NO JOINTS IN THIS ZONE.
R 	RESTRICTED. NO WATER MAINS WILL BE ALLOWED WITHOUT STATE DEPARTMENT OF PUBLIC HEALTH APPROVAL.
P 	PROHIBITED. NO WATER MAINS ARE TO BE CONSTRUCTED IN THIS ZONE.

NOTES:

1. THIS DRAWING DOES NOT INDICATE CONSTRUCTION REQUIREMENTS WHEN EXISTING SEWER IS A FORCE MAIN. CONSULT STATE DEPARTMENT OF PUBLIC HEALTH REGULATIONS.
2. THIS DRAWING ASSUMES THAT NO SPECIAL CONSTRUCTION METHODS HAVE BEEN USED FOR SEWER INSTALLATION.

Fair Oaks Water District

10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
 OFFICE (916) 987-5723, FAX (916) 987-0153
 WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

WATER AND SEWER MAINS SEPARATION REQUIREMENTS

Standard Drawing 10

APPROVED:
M. NISENBOYM
 DRAWN BY
T. EGGAR
 DRAWING
STD-10
 REVISED
AUG 2007
 SCALE
N/A

Standard Specifications