


J:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-Dwg_FOWD\Dwg\Std-18-ValveAnchor.dwg, 11/26/07 03:28:36pm, time

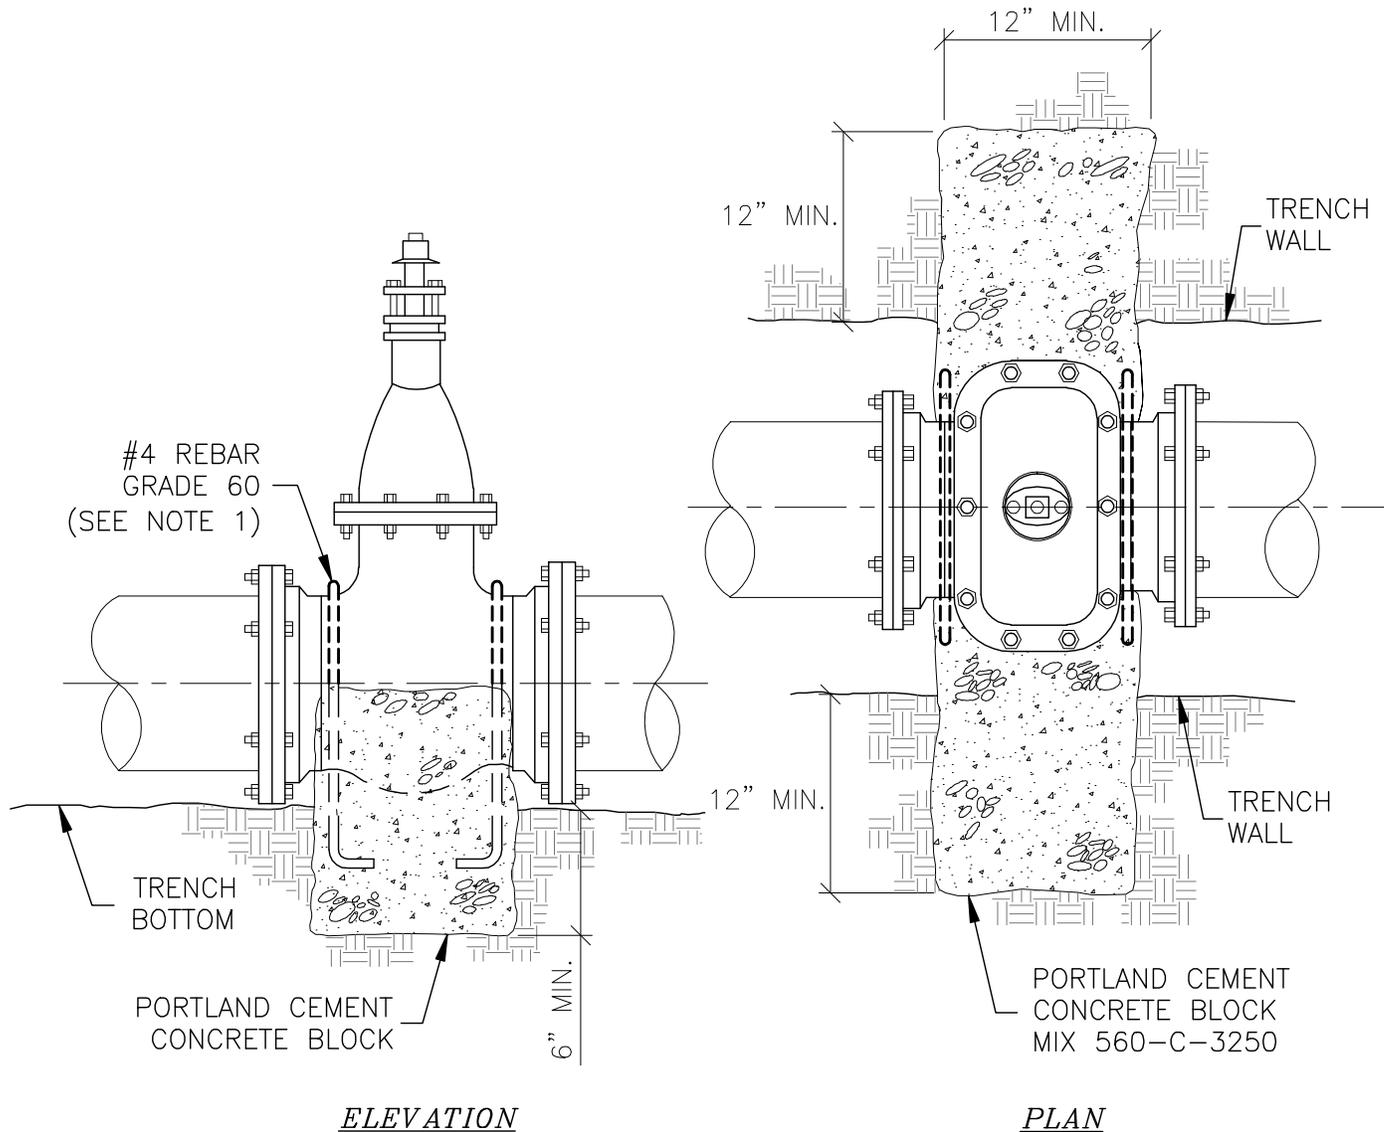

NOTES:

1. ALL ANCHOR RODS ARE TO BE COVERED WITH BITUMASTIC COMPOUND.
2. THE ANCHOR BLOCK SHALL BE KEYPED NO LESS THAN 12 INCHES INTO UNDISTURBED SOIL OF THE TRENCH WALL AND NO LESS THAN 6 INCHES INTO THE TRENCH BOTTOM.
3. ANCHORS ARE TO BE INSTALLED ON ALL VALVES 8" AND LARGER UNLESS OTHERWISE NOTED ON PLANS.
4. ALL VALVE RISERS SHALL BE 8" PVC C900. IF VALVES ARE IN CONCRETE, USE G-5 VALVE BOX W G-5-C CAST IRON LID OR FOWD APPROVED EQUIVALENT.

Fair Oaks Water District
 10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
 OFFICE (916) 967-5723, FAX (916) 967-0153
 WEBSITE: WWW.FOWD.COM



**FAIR OAKS
 WATER DISTRICT**

VALVE ANCHOR

Standard Drawing 18

APPROVED:
 M. NISENBOYM
 DRAWN BY
 T. EGGAR
 DRAWING
STD-18
 REVISED
 AUG 2007
 SCALE
 N/A

Standard Specifications