
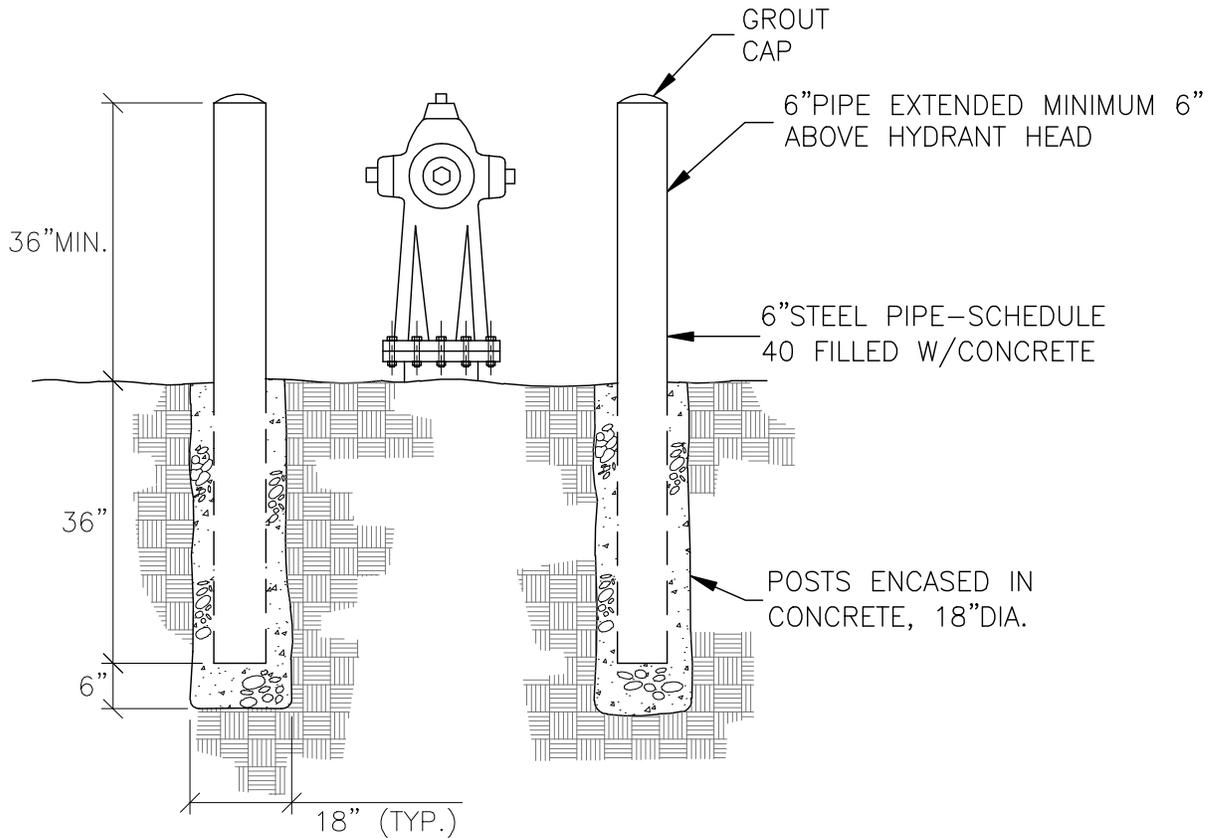


J:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-Dwg FOWD\dwgs\Std-19-FH-Barricade.dwg, 11/15/07 03:01:25pm, time

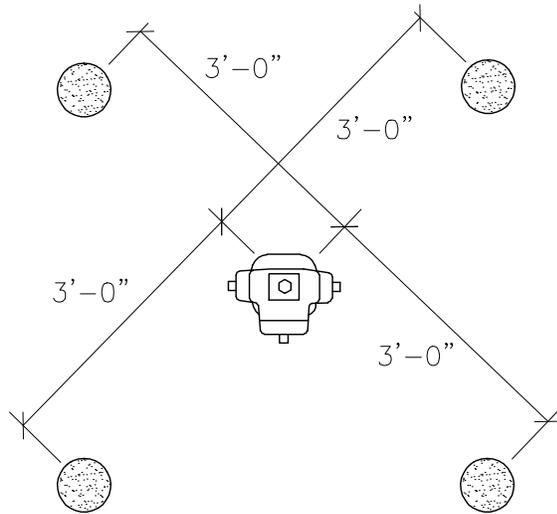

NOTES:

1. ORIENTATION OF BARRICADE MAY BE CHANGED ACCORDING TO FIELD CONDITIONS.
2. BARRICADE AND HYDRANT ARE TO BE PAINTED PER LOCAL FIRE DEPARTMENT REQUIREMENTS, CONTRACTOR TO SUPPLY PAINT AND PRIMER.
3. COATING SHALL BE PER COMPANY PAINTING SPECIFICATIONS FOR ABOVE GRADE STEEL PIPING.

Fair Oaks Water District
 10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
 OFFICE (916) 967-5723, FAX (916) 967-0153
 WEBSITE: WWW.FOWD.COM



FIRE HYDRANT BARRICADE

APPROVED:
 M. NISENBOYM
 DRAWN BY
 T. EGGAR
 DRAWING
STD-19
 REVISED
 AUG 2007
 SCALE
 N/A

Standard Specifications

Standard Drawing 19