


N:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-22-ManifoldMeter.dwg, 08/08/16 10:08:47am, teggar

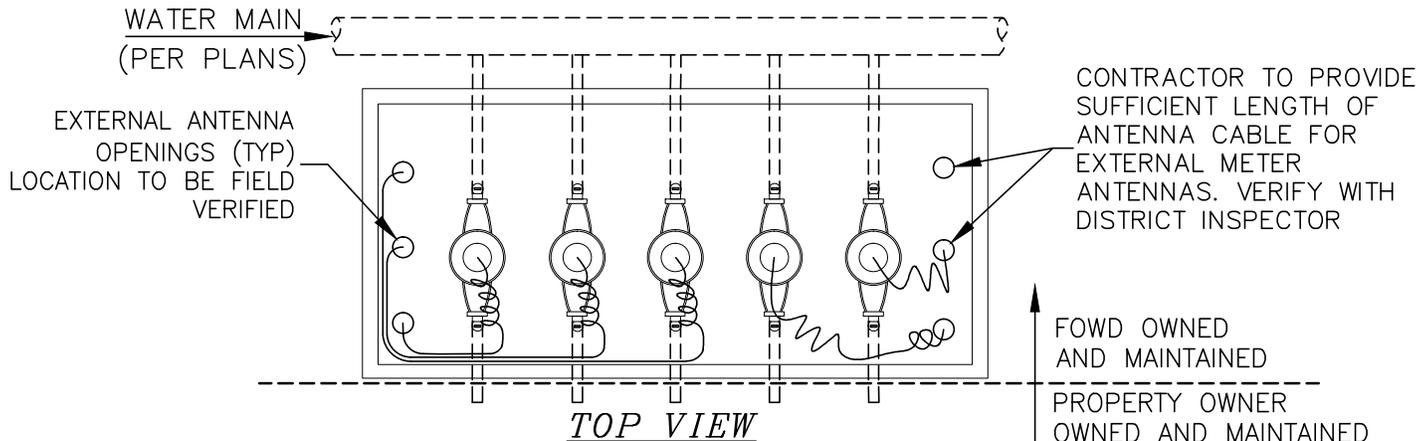

TOP VIEW


JENSEN MODEL SC3672-THGV,
TRAFFIC RATED GALVANIZED
SPRING ASSISTED COVER OR
APPROVED EQUAL

EXTERNAL ANTENNA
(PER FOWD SPECS)


CONNECTION WIRE
(PER FOWD SPECS.)
METER
(PER FOWD SPECS)

NOTE:
REFER TO FOWD STD-7
FOR METER INSTALLATION.
(TYPICAL FOR ALL METERS)

VAULT LID TO BE RATED (H20)
IN TRAFFIC AREAS WITH SPRING
LOADED TORSION ASSIST
DOORS.

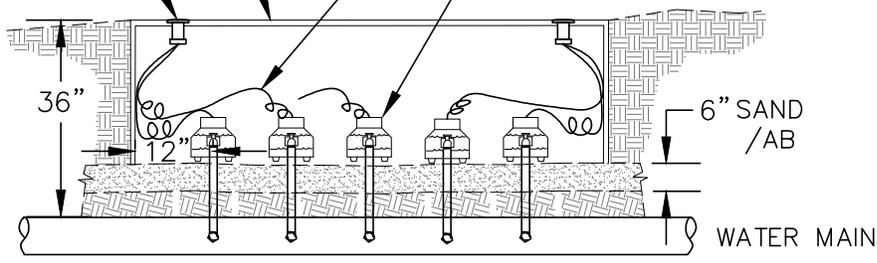

FRONT VIEW

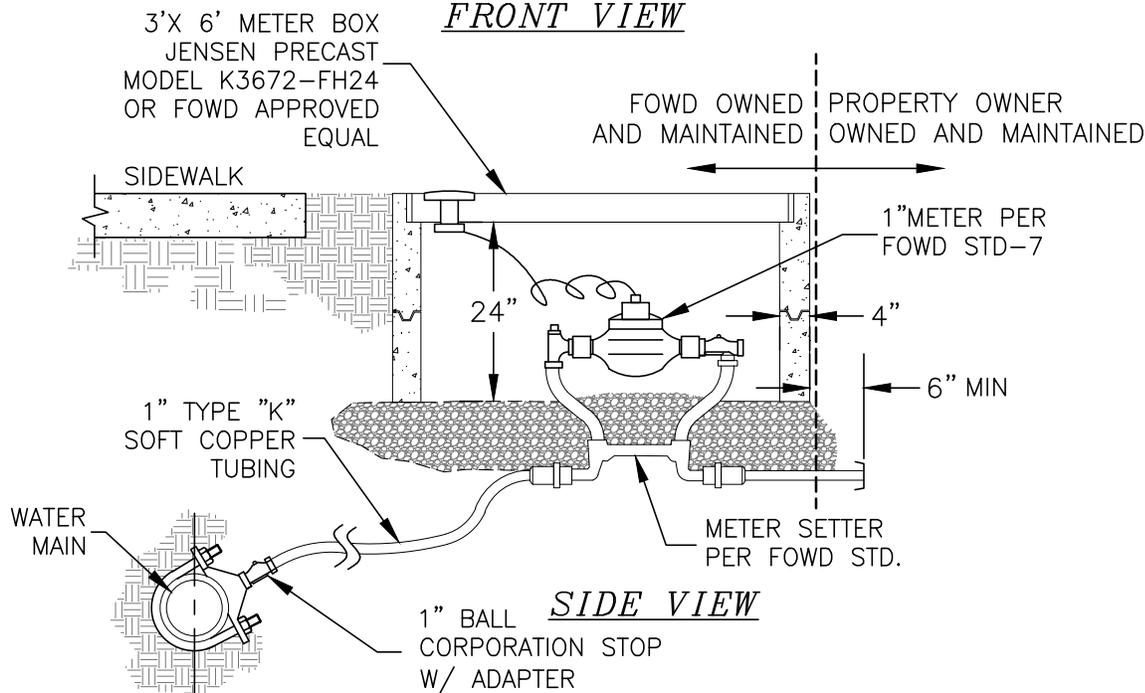

SIDE VIEW

Fair Oaks Water District
10326 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
OFFICE (916) 967-5723, FAX (916) 967-0153
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

**MULTIPLE METER MANIFOLD
FOR 1" SERVICES**

Standard Specifications

Standard Drawing 22

APPROVED:
M. NISENBOYM
DRAWN BY
T. EGGAR
DRAWING
STD-22
REVISED
JULY-2016
SCALE
N/A