



N:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-Dwg\_FOWD\Dwg\Std-10-WaterSewer-separation.dwg, 01/12/10 03:32:16pm, teggarr

EXISTING SEWER—NEW WATER MAIN

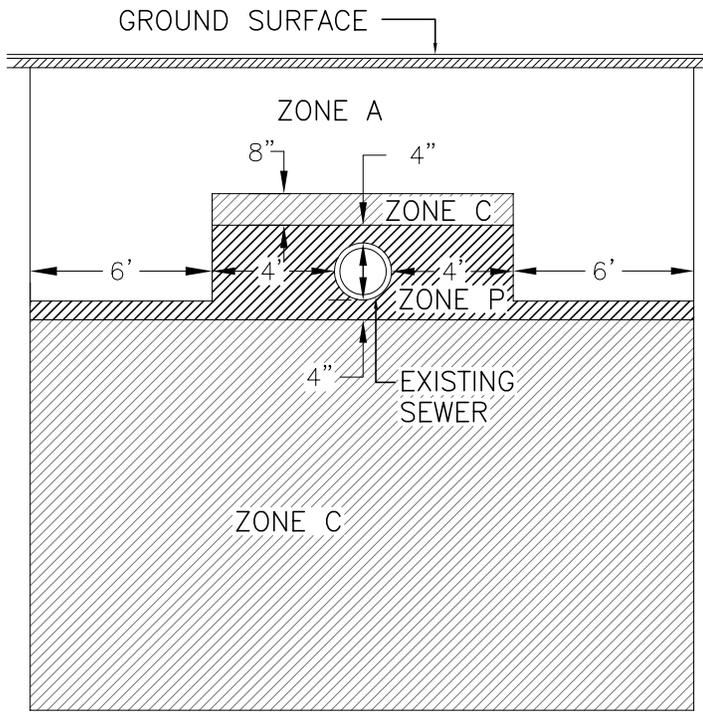

PERPENDICULAR CONSTRUCTION

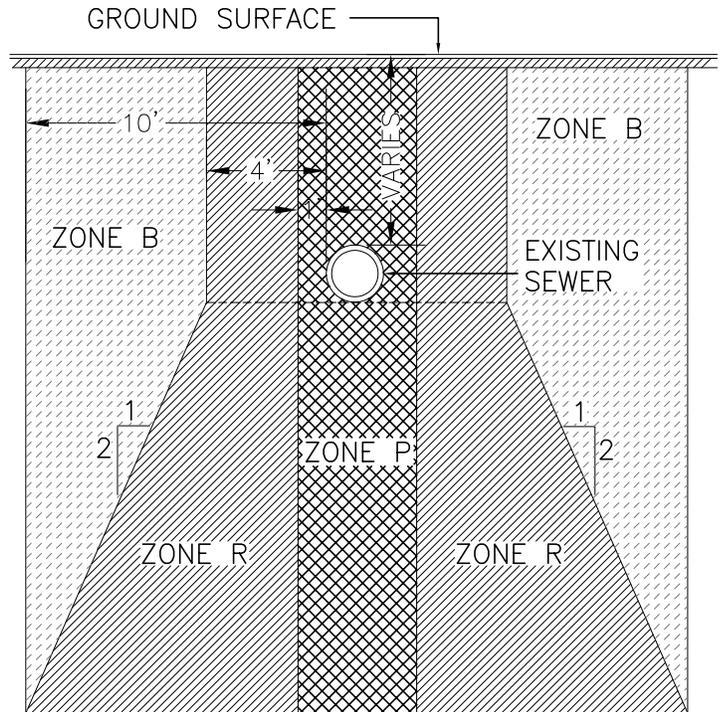

PARALLEL CONSTRUCTION

ZONE	CONSTRUCTION REQUIREMENTS
A	NO SPECIAL REQUIREMENTS.
B	THE WATER MAIN SHALL BE CLASS 200 PIPE.
C	THE WATER MAIN SHALL BE APPROVED CLASS 200 PLASTIC PIPE CONFORMING TO DR 14 PER AWWA C900 OR D.I. CL350 PIPE WITH HOT DIP BITUMINOUS COATING. THERE SHALL BE NO JOINTS IN THIS ZONE.
R	RESTRICTED. NO WATER MAINS WILL BE ALLOWED WITHOUT STATE DEPARTMENT OF PUBLIC HEALTH APPROVAL.
P	PROHIBITED. NO WATER MAINS ARE TO BE CONSTRUCTED IN THIS ZONE.

NOTES:

1. THIS DRAWING DOES NOT INDICATE CONSTRUCTION REQUIREMENTS WHEN EXISTING SEWER IS A FORCE MAIN. CONSULT STATE DEPARTMENT OF PUBLIC HEALTH REGULATIONS.
2. THIS DRAWING ASSUMES THAT NO SPECIAL CONSTRUCTION METHODS HAVE BEEN USED FOR SEWER INSTALLATION.

**Fair Oaks Water District**  
 10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187  
 OFFICE (916) 967-5723, FAX (916) 967-0153  
 WEBSITE: W W W.FOWD.COM

---

Standard Specifications



**WATER AND SEWER MAINS SEPARATION REQUIREMENTS**

---

Standard Drawing 10

APPROVED: M. NISENBOYM
DRAWN BY T. EGGAR
DRAWING <b>STD-10</b>
REVISED JAN-2010
SCALE N/A