
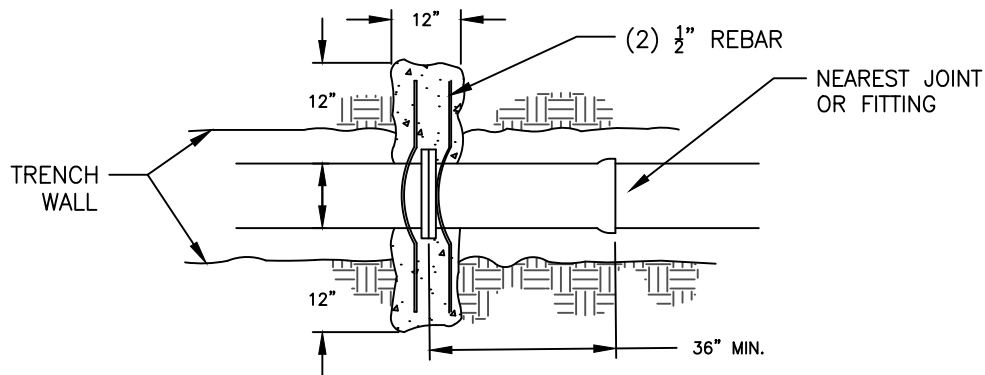


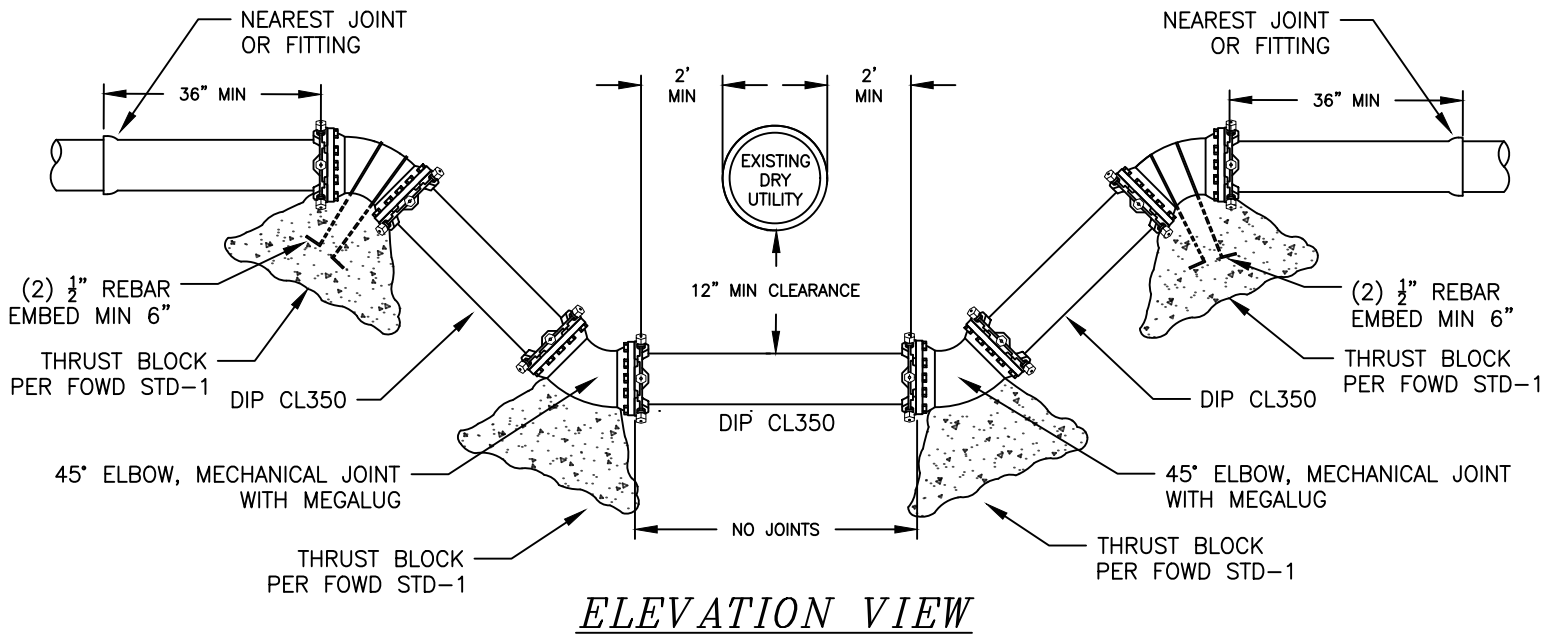

NOTES:

1. WATER MAINS SHALL NOT BE INSTALLED BELOW STORM DRAIN, SEWER, RECYCLED WATER, OR HAZARDOUS FLUID. WRITTEN APPROVAL FROM THE CALIFORNIA STATE WATER RESOURCES CONTROL BOARD, DIVISION OF DRINKING WATER (DDW), MUST BE OBTAINED BY FOWD IF ANY SUCH INSTALLATION IS REQUIRED.
2. WHEN CROSSING EXISTING UTILITIES AS DESCRIBED IN NOTE 1, NO PIPE JOINTS ARE ALLOWED WITHIN 8 FEET ON EITHER SIDE OF THE CROSSING. IF CROSSING EXCEEDS 18 FEET, CONNECT PIPE SECTIONS WITH FIELD LOK GASKETS.
3. FIELD LOK GASKETS OR APPROVED EQUAL ARE TO BE INSTALLED A MINIMUM OF ONE PIPE SEGMENT BEFORE AND AFTER EACH INVERT.
4. ALL MECHANICAL JOINT (MJ) CONNECTIONS SHALL BE COUPLED WITH MEGALUGS.
5. ALL BURIED METAL SHALL BE ENCASED WITH 8 MIL POLY WRAP.
6. PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

**UTILITY CROSSING
INVERT DETAIL**

STANDARD DRAWING 10

APPROVED:	B. CHETCUTI
DRAWN BY:	D. LEE
DRAWING:	STD-10
REVISED:	JUNE 2026
SCALE:	NONE

STANDARD SPECIFICATIONS