


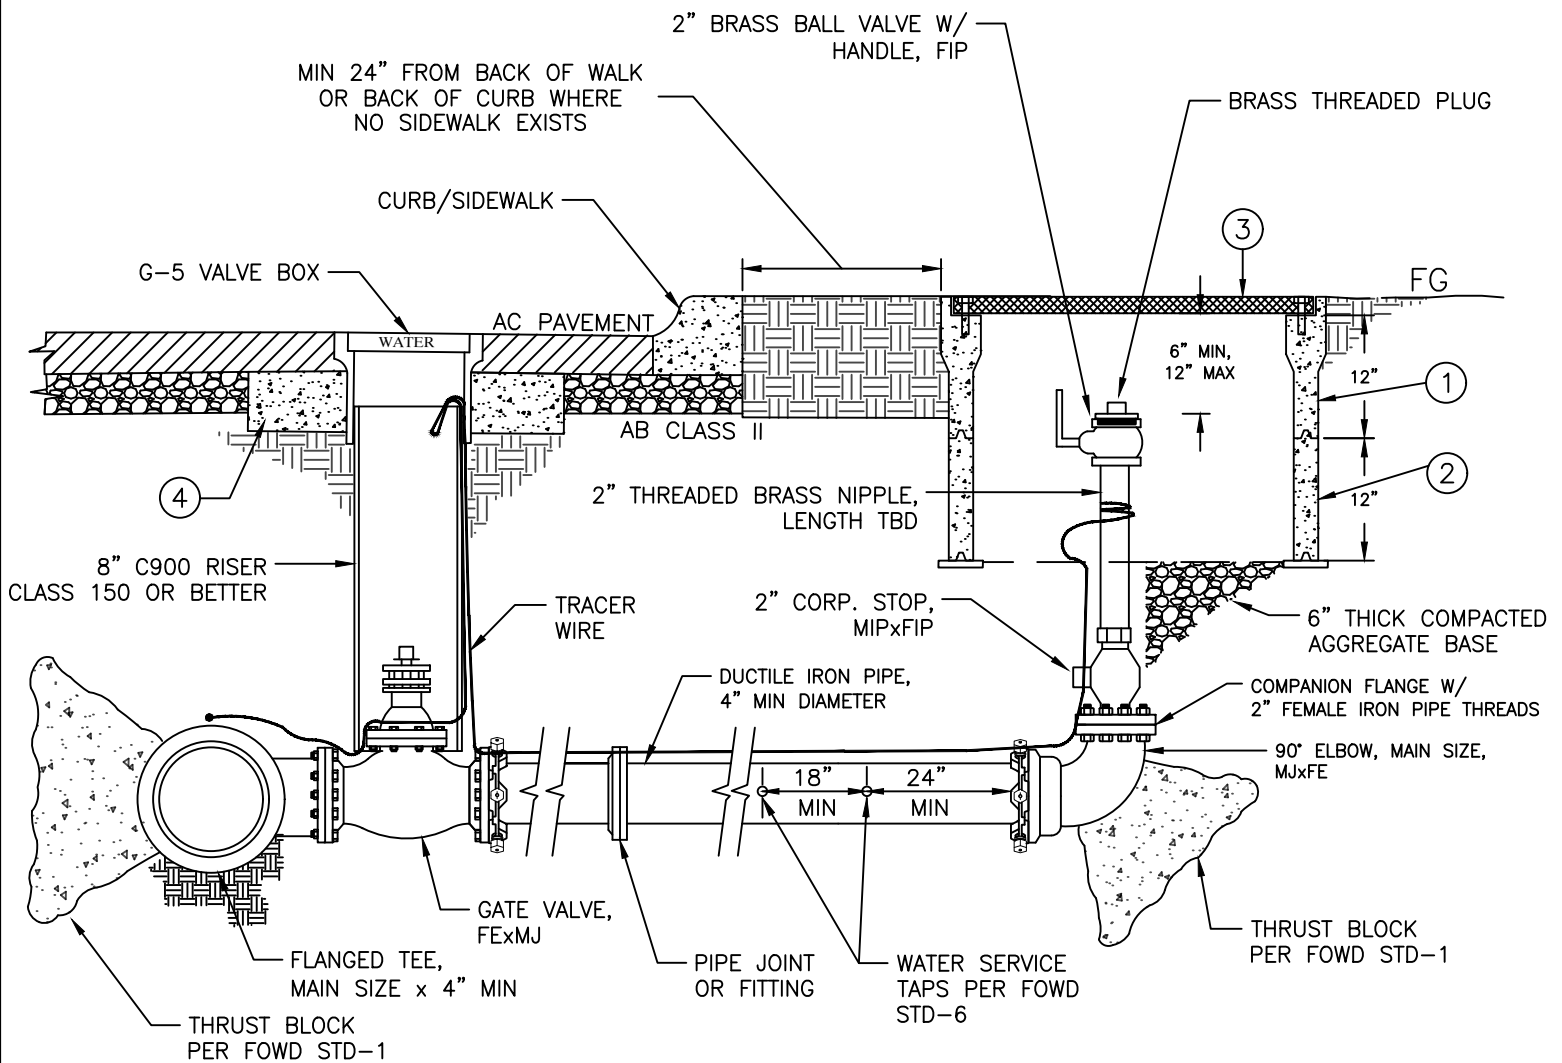

NOTES:

- ① CHRISTY MODEL B1324 HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTLING SHOULDERS OR FOWD APPROVED EQUAL.
- ② CHRISTY MODEL B1324x12 EXTENSION RISER.
- ③ CHRISTY MODEL B1324-61JH STEEL H/20 TRAFFIC RATED LID MARKED "WATER" WITH BOLT DOWN.
- ④ 6"x6" THICK CIRCULAR CONCRETE UNDER AC PER SACRAMENTO COUNTY STANDARDS.
5. CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING FINISHED GRADE PRIOR TO INSTALLATION. SEE FOWD STD-6 FOR WATER SERVICE AND WATER METER LAYOUT.
6. BLOWOFF FOR BULLHEAD SERVICES SHALL BE INSTALLED BEHIND THE SIDEWALK OR BACK OF CURB WITH BOX LID FLUSH WITH ADJACENT GRADE.
7. PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.
8. ALL BURIED METAL SHALL BE ENCASED WITH 8 MIL POLY WRAP.
9. ALL MECHANICAL JOINT (MJ) CONNECTIONS SHALL BE COUPLED WITH MEGALUGS.
10. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.
11. VALVE BOX AND RISER SHALL BE SET PLUMB AND CENTERED OVER GATE VALVE NUT.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

**BULLHEAD SERVICE
INSTALLATION**

STANDARD DRAWING 7

APPROVED:	B. CHETCUTI
DRAWN BY:	D. LEE
DRAWING:	STD-7
REVISED:	JUNE 2026
SCALE:	NONE

STANDARD SPECIFICATIONS