


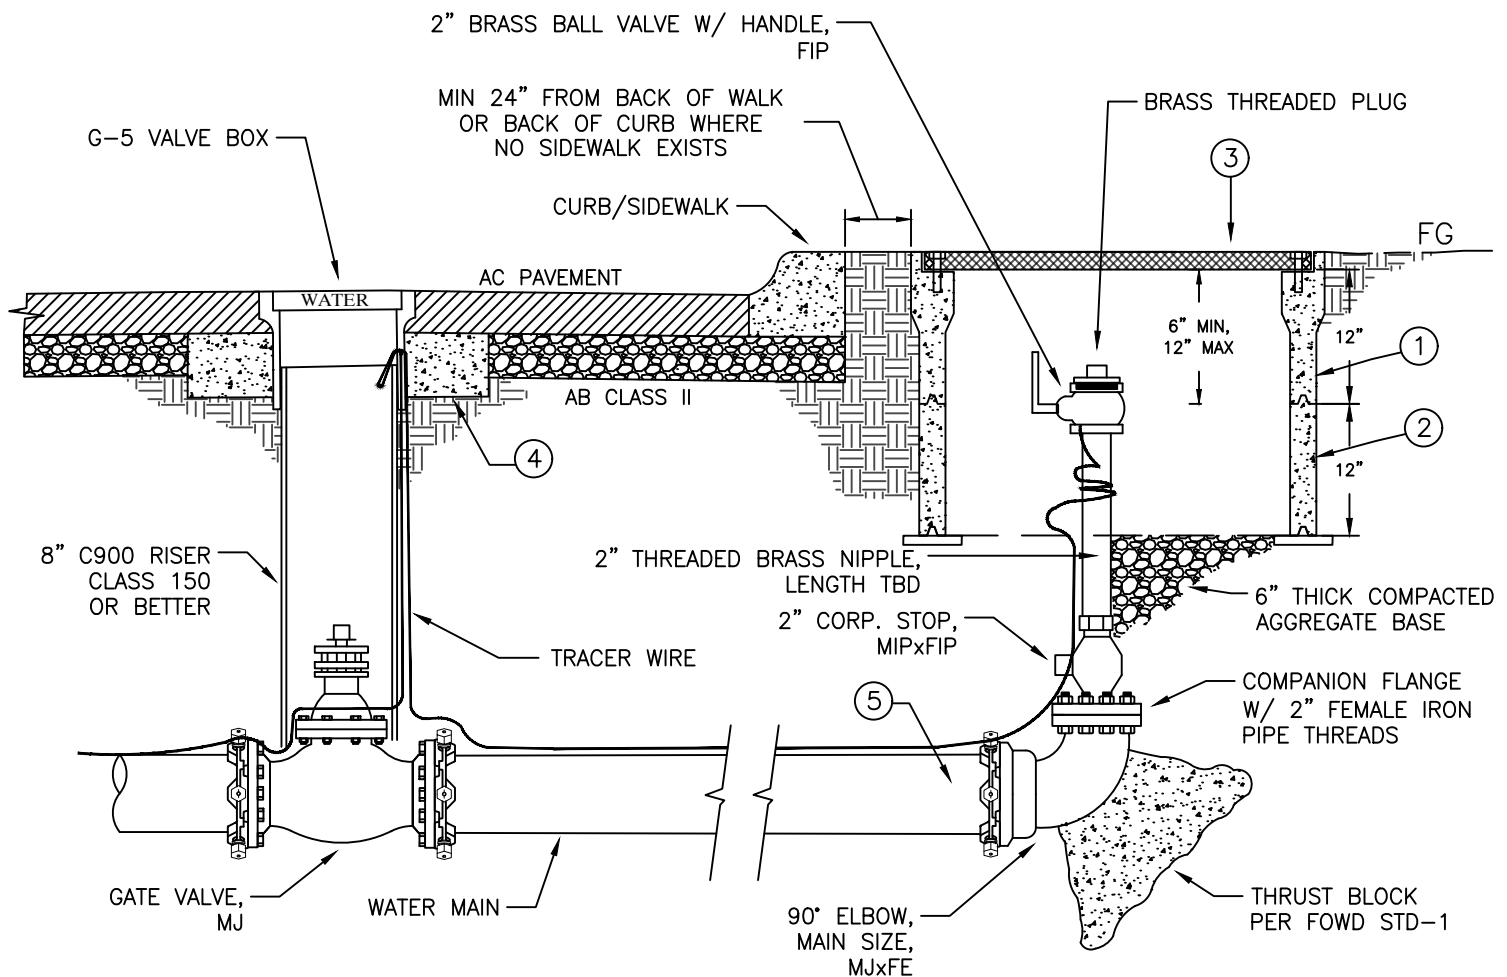


NOTES:

- ①. CHRISTY MODEL B1324 HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTLING SHOULDERS OR FOWD APPROVED EQUAL.
- ②. CHRISTY MODEL B1324X12 EXTENSION RISER.
- ③. CHRISTY MODEL B1324-61JH STEEL H/20 TRAFFIC RATED LID MARKED "WATER" WITH BOLT DOWN.
- ④. 6"X6" THICK CIRCULAR CONCRETE UNDER AC PER SACRAMENTO COUNTY STANDARDS.
- ⑤. CONNECTION TO AC MAIN REQUIRES INSTALLATION OF A FLEX COUPLING AND PUP (PVC OR DUCTILE IRON) NO LESS THAN 36" FROM 90° ELBOW.
6. FOR APPLICATIONS THAT REQUIRE GREATER THAN A 2 INCH END OF MAIN BLOWOFF, INSTALL FIRE HYDRANT PER FOWD STD-9.
7. PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.
8. ALL BURIED METAL SHALL BE ENCASED WITH 8 MIL POLY WRAP.
9. ALL MECHANICAL JOINT (MJ) CONNECTIONS SHALL BE COUPLED WITH MEGALUGS.
10. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.
11. VALVE BOX AND RISER SHALL BE SET PLUMB AND CENTERED OVER GATE VALVE NUT.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

2" END OF MAIN BLOW OFF

STANDARD DRAWING 3

APPROVED: B. CHETCUTI

DRAWN BY: D. LEE

DRAWING: STD-3

REVISED: JUNE 2026

SCALE: NONE

STANDARD SPECIFICATIONS