


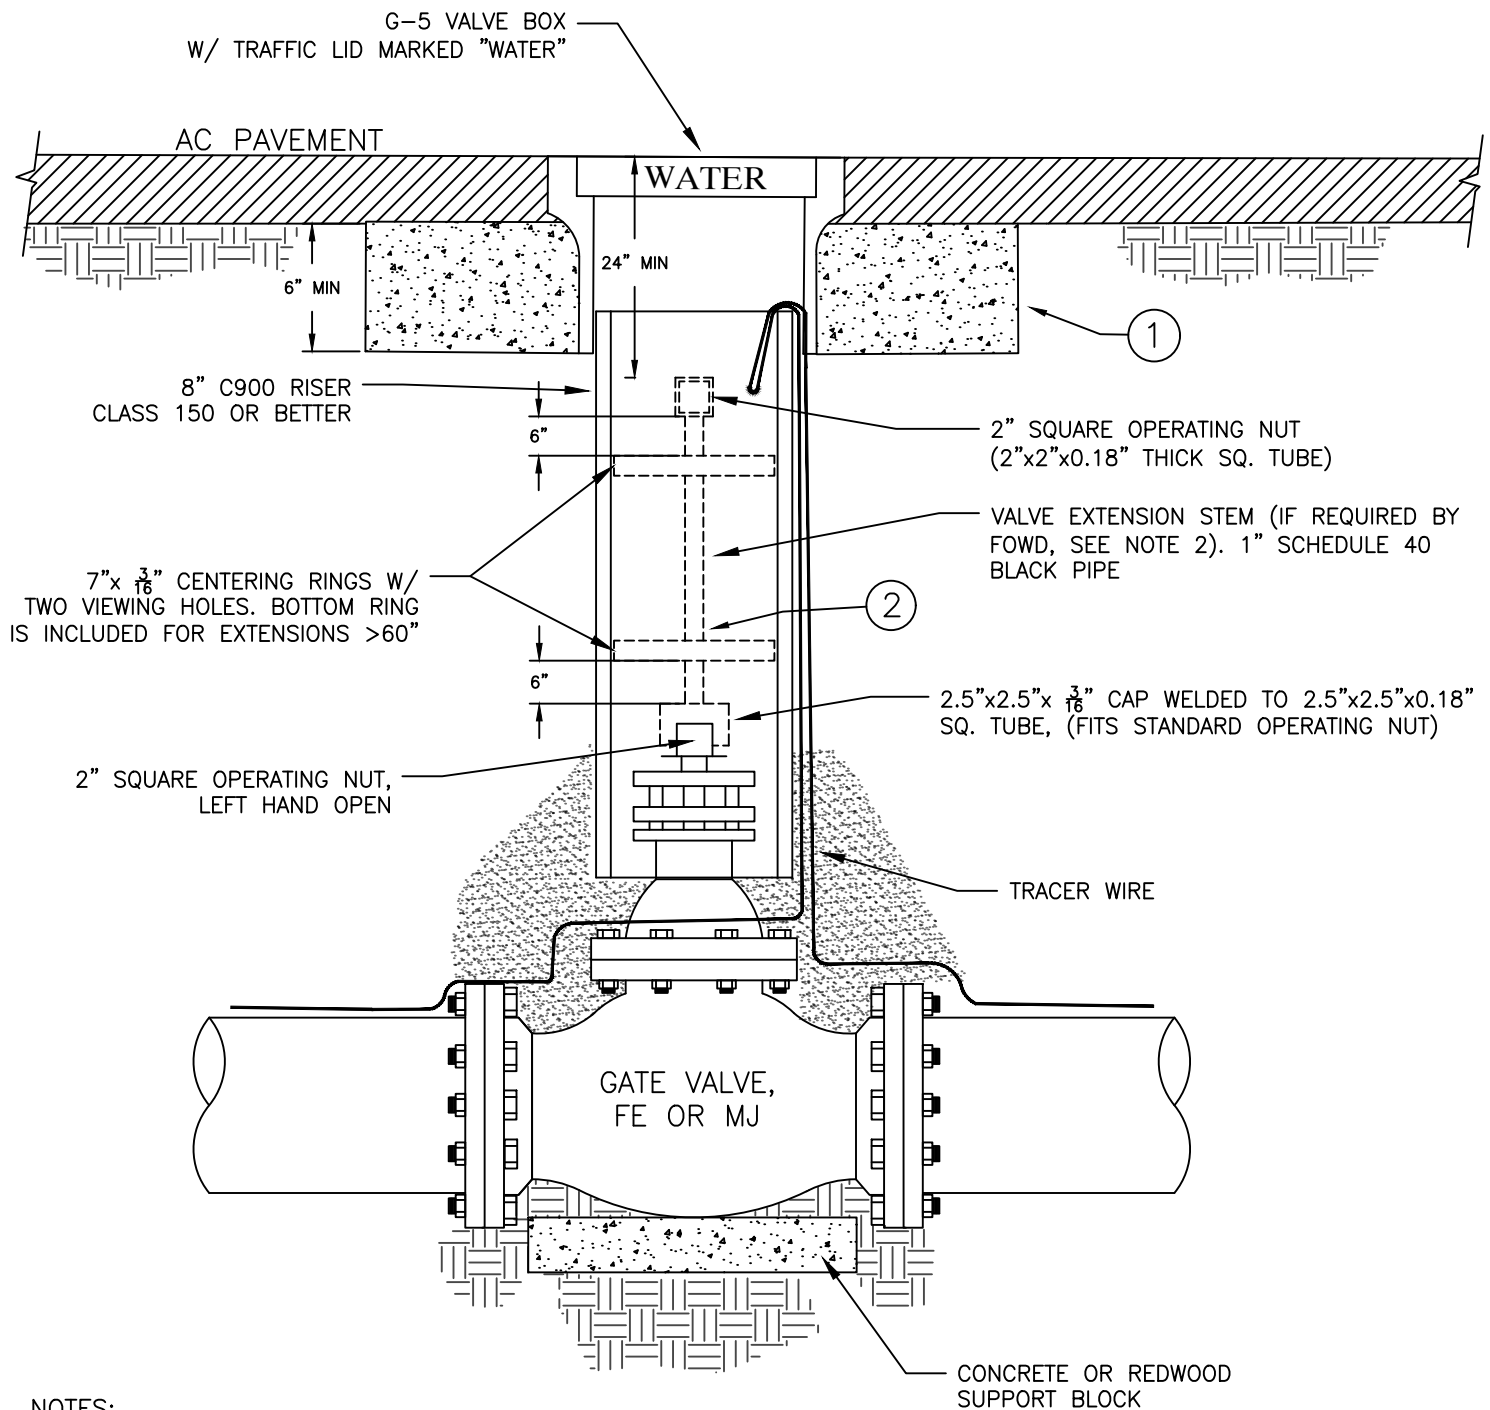

NOTES:

- ① 6"x6" THICK CIRCULAR CONCRETE COLLAR UNDER AC PER SACRAMENTO COUNTY STANDARDS.
- ② VALVE STEM EXTENSION IS REQUIRED IF VALVE NUT IS LOCATED MORE THAN 42" BELOW GRADE. SHALL BE HOOKS AND PROBES VALVE STEM EXTENSION OR APPROVED EQUAL.
3. PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.
4. ALL BURIED METAL SHALL BE ENCASED WITH 8 MIL POLY WRAP.
5. ALL MECHANICAL JOINT (MJ) CONNECTIONS SHALL BE COUPLED WITH MEGALUGS.
6. VALVE BOX AND RISER SHALL BE SET PLUMB AND CENTERED OVER GATE VALVE NUT.
7. FOR MAINS 16 INCHES AND LARGER, SUBSTITUTE BUTTERFLY VALVE FOR GATE VALVE.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

IN-LINE GATE VALVE

STANDARD DRAWING 4

APPROVED: B. CHETCUTI
DRAWN BY: D. LEE
DRAWING: STD-4
REVISED: JUNE 2026
SCALE: NONE

STANDARD SPECIFICATIONS