


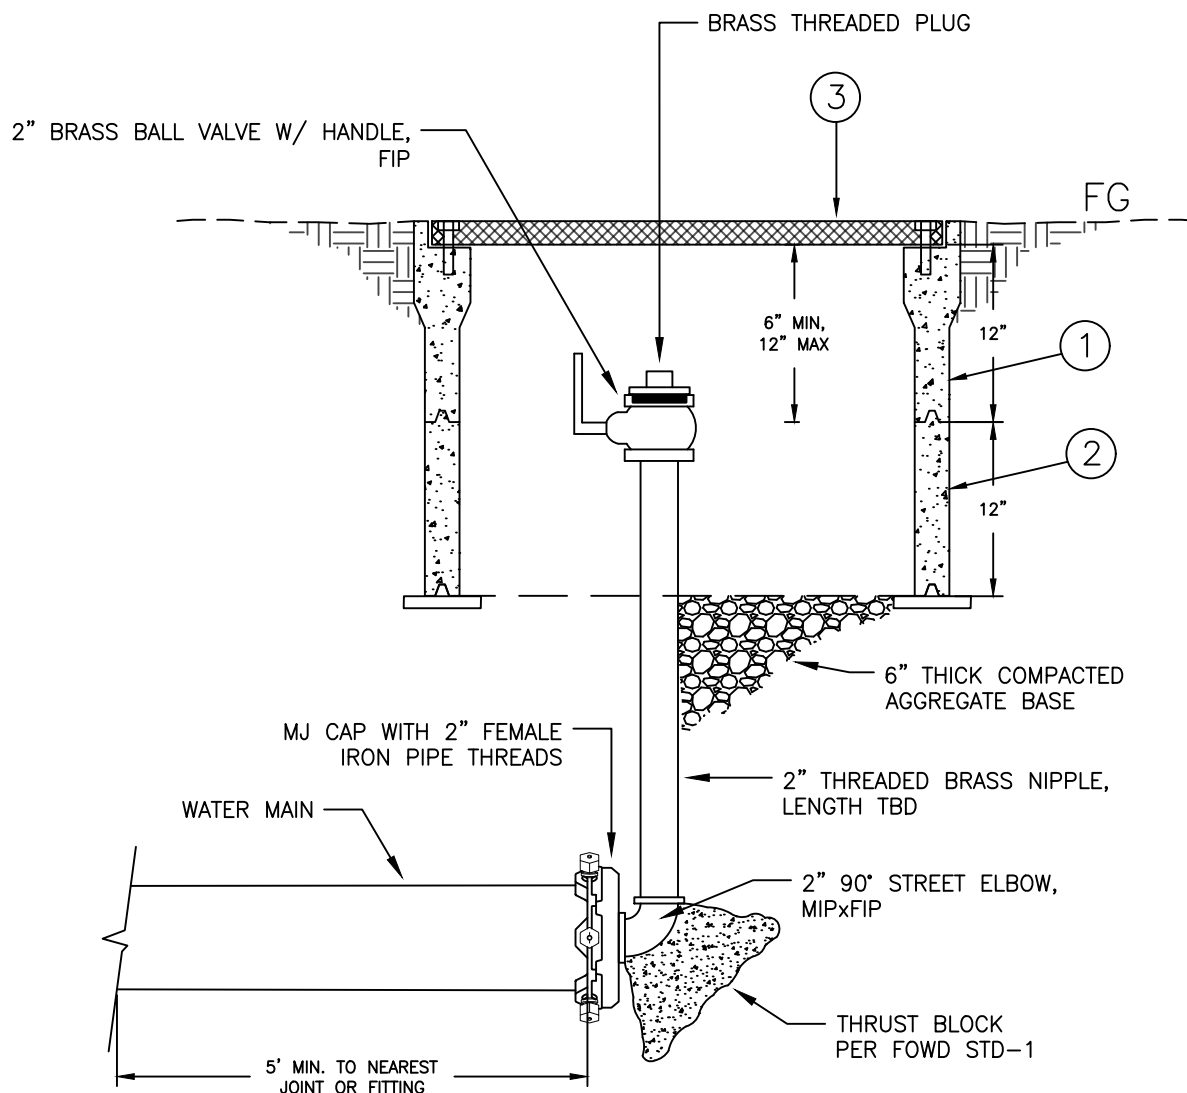

NOTES:

- ① CHRISTY MODEL B1324 HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTLING SHOULDERS OR FOWD APPROVED EQUAL.
- ② CHRISTY MODEL B1324X12 EXTENSION RISER.
- ③ CHRISTY MODEL B1324-61JH STEEL H/20 TRAFFIC RATED LID MARKED "WATER" WITH BOLT DOWN.
4. FOR MAINS 16 INCHES AND LARGER, SUBSTITUTE PARTS TO 4 INCH.
5. ALL BURIED METAL SHALL BE WRAPPED WITH 10 MIL POLY TAPE.
6. ALL MECHANICAL JOINT (MJ) CONNECTIONS SHALL BE COUPLED WITH MEGALUGS.
7. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

TEMPORARY BLOW OFF FOR CONSTRUCTION

STANDARD DRAWING 3-3

APPROVED:
B. CHETCUTI

DRAWN BY:
D. LEE

DRAWING:
STD-3-3

REVISED:
JUNE 2026

SCALE:
NONE

STANDARD SPECIFICATIONS