


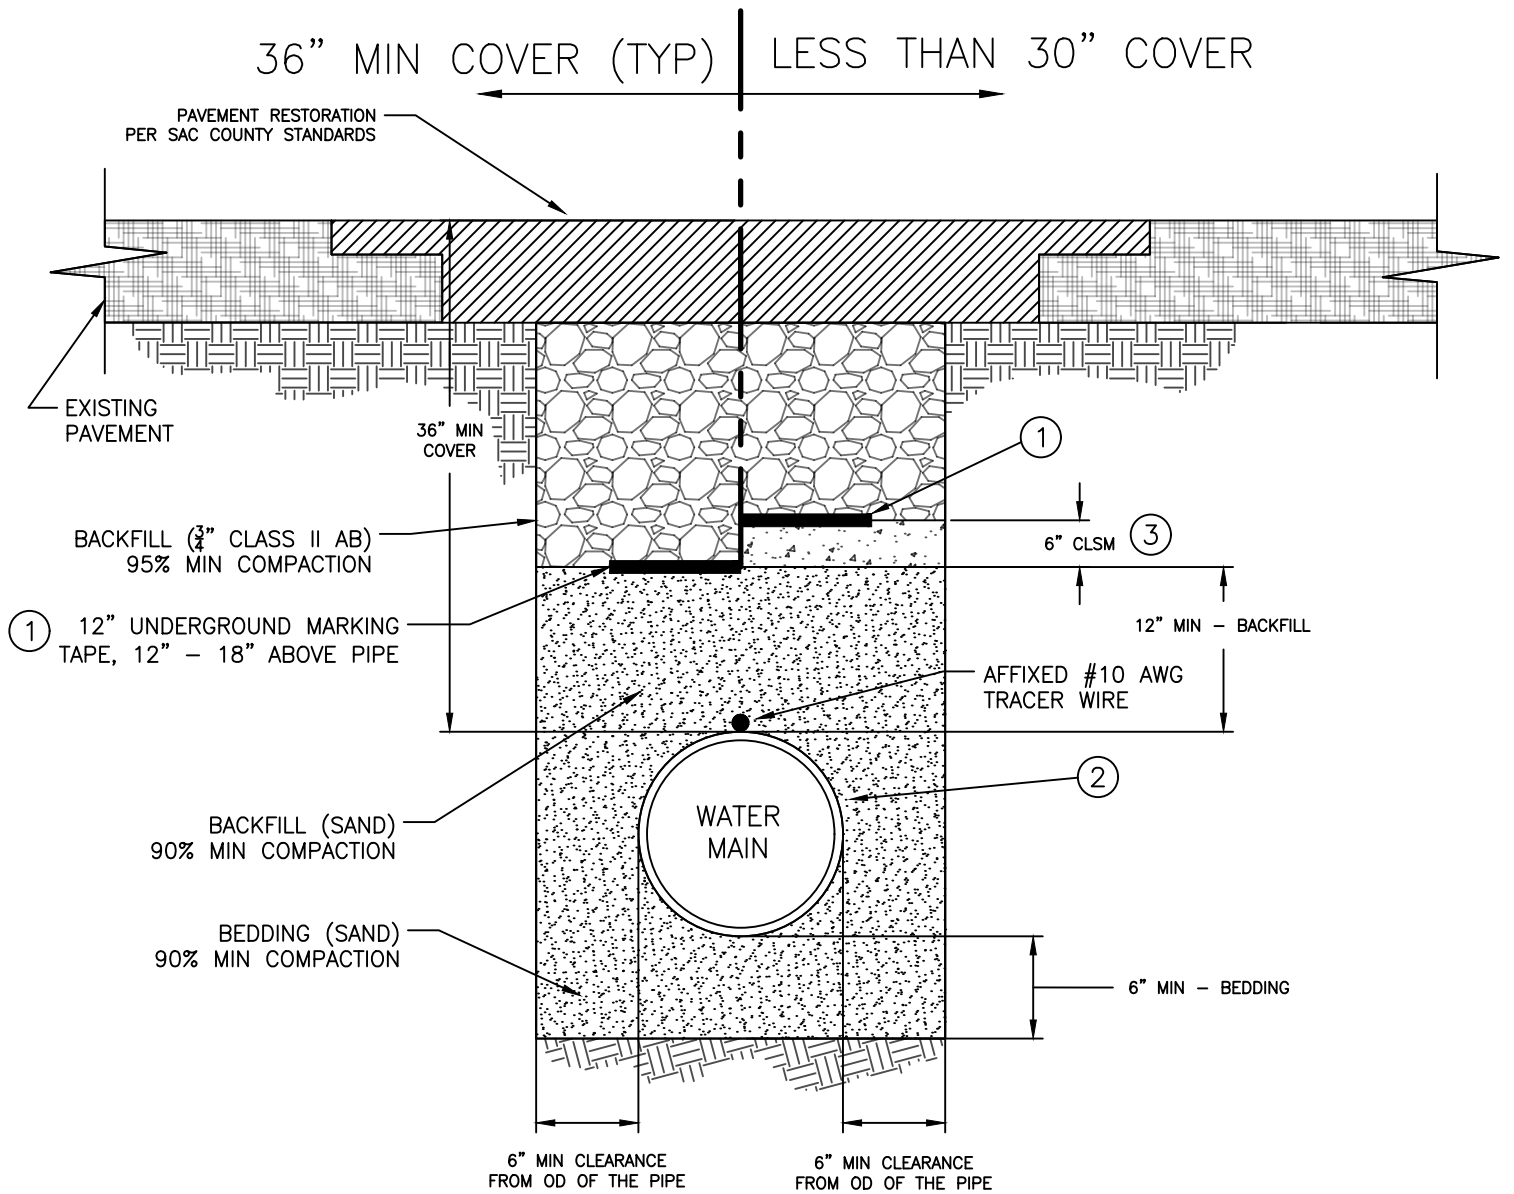

NOTES:

- ① WARNING TAPE SHALL BE INSTALLED ABOVE ALL TRENCHED WATER FACILITY INSTALLATIONS. TAPE SHALL BE 12" WIDE (PROVIDE TWO TAPE RUNS FOR 16" AND LARGER DIAMETER PIPE). TAPE SHALL BE BLUE, MARKED **"WATER MAIN BURIED BELOW"** IN BOLD BLACK LETTERING.
- ② PIPES INSTALLED WITH LESS THAN 30" OF COVER SHALL BE DUCTILE IRON.
- ③ PIPES INSTALLED WITH LESS THAN 30" OF COVER SHALL HAVE 6" OF CONTROLLED LOW STRENGTH MATERIAL (CLSM) CONFORMING TO SACRAMENTO COUNTY STANDARDS BETWEEN THE COMPACTED SAND AND AB LAYERS.
4. TRENCH BACKFILL AND SURFACE RESTORATION MUST CONFORM TO SACRAMENTO COUNTY STANDARDS.
5. NO NATIVE BACKFILL TO BE ALLOWED IN TRENCHES CONTAINING FOWD WATER FACILITIES.
6. MAXIMUM LENGTH OF OPEN TRENCH SHALL BE 100 FEET OR AS APPROVED BY FOWD.
7. SAND AND CLASS II AGGREGATE BASE SHALL BE COMPACTED IN 12" LIFTS.
8. THIS STANDARD APPLIES TO ALL TRENCHED WATER FACILITY INSTALLATIONS.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

TRENCH DETAIL

STANDARD DRAWING 8

APPROVED: B. CHETCUTI

DRAWN BY: D. LEE

DRAWING: STD-8

REVISED: JUNE 2026

SCALE: NONE

STANDARD SPECIFICATIONS