


ELEVATION VIEW

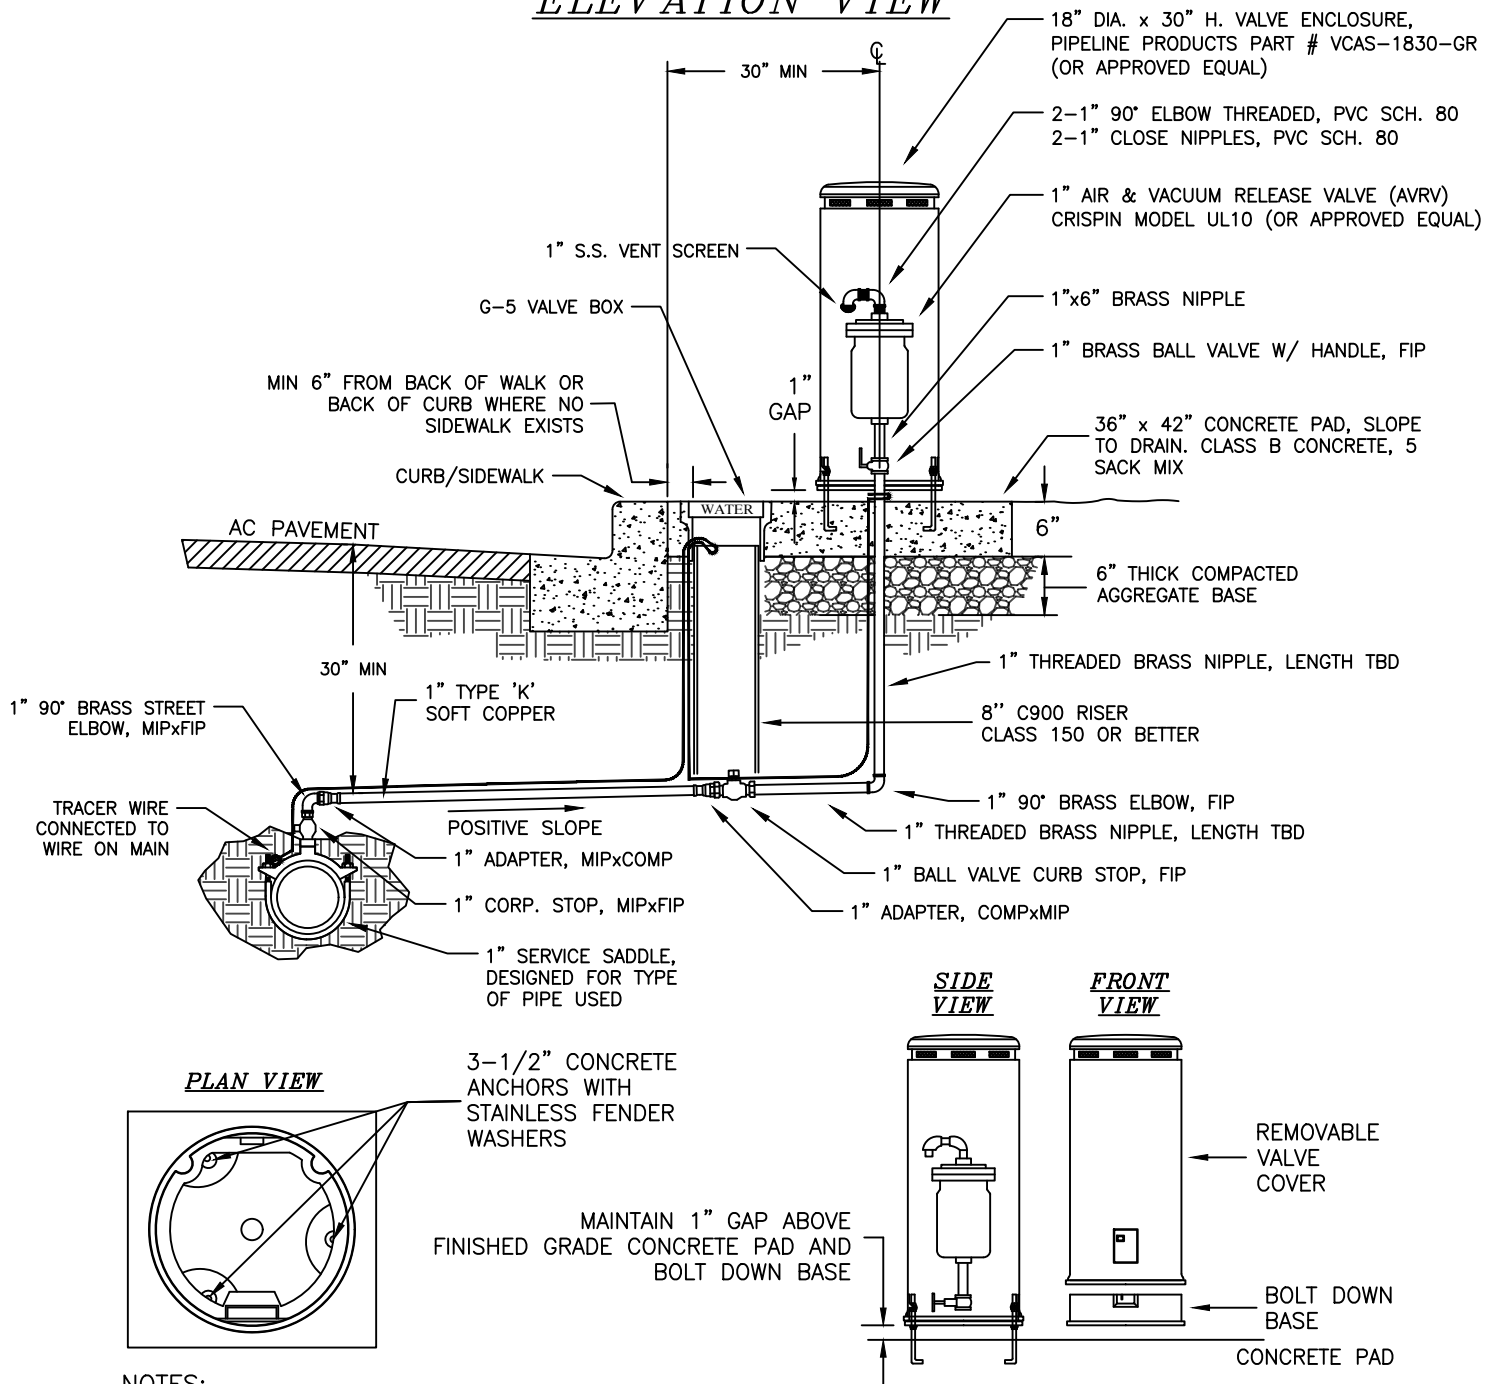

NOTES:

1. ALL BURIED METAL SHALL BE WRAPPED WITH 10 MIL POLY TAPE.
2. PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.
3. VALVE BOX AND RISER SHALL BE SET PLUMB AND CENTERED OVER VALVE NUT.
4. MAINTAIN POSITIVE SLOPE TO AIR AND VACUUM RELEASE VALVE (AVRV).
5. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.
6. AVRV TO BE INSTALLED AT THE HIGH POINT OF THE MAIN AS PER PLAN.
7. FOR MAINS 16 INCHES AND LARGER, SUBSTITUTE PARTS TO 2 INCH.
8. INSTALLATION OF BOLLARDS MAY BE REQUIRED AS DIRECTED BY FOWD.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

1" & 2" AIR & VACUUM RELEASE VALVE

STANDARD DRAWING 2

APPROVED:	B. CHETCUTI
DRAWN BY:	D. LEE
DRAWING:	STD-2
REVISED:	JUNE 2026
SCALE:	NONE

STANDARD SPECIFICATIONS