


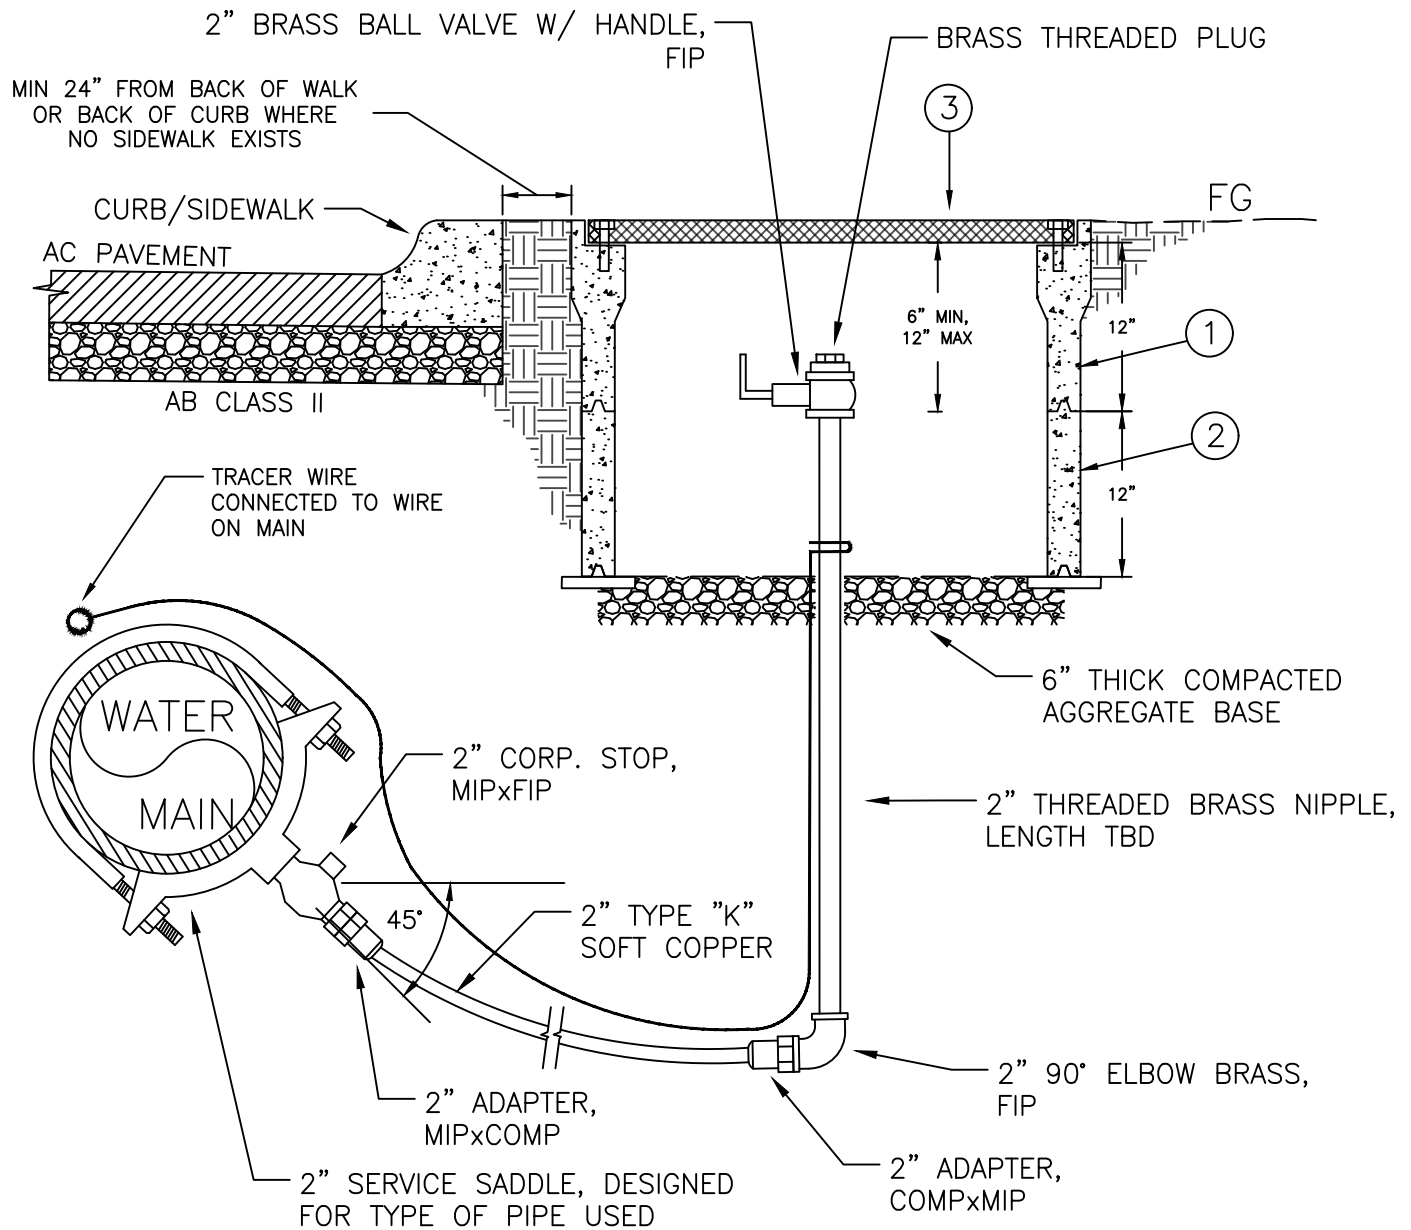

NOTES:

- ①. CHRISTY MODEL B1324 HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTLING SHOULDERS OR FOWD APPROVED EQUAL.
- ②. CHRISTY MODEL B1324X12 EXTENSION RISER.
- ③. CHRISTY MODEL B1324-61JH STEEL H/20 TRAFFIC RATED LID MARKED "WATER" WITH BOLT DOWN.
4. INSTALL BLOW OFF AT LOW POINT OF WATER MAIN.
5. ALL BURIED METAL SHALL BE WRAPPED WITH 10 MIL POLY TAPE.
6. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.
7. FOR MAINS 16 INCHES AND LARGER, REFER TO STANDARD 3-2.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

2" IN-LINE BLOW OFF

STANDARD DRAWING 3-1

APPROVED: B. CHETCUTI

DRAWN BY: D. LEE

DRAWING: STD-3-1

REVISED: JUNE 2026

SCALE: NONE

STANDARD SPECIFICATIONS