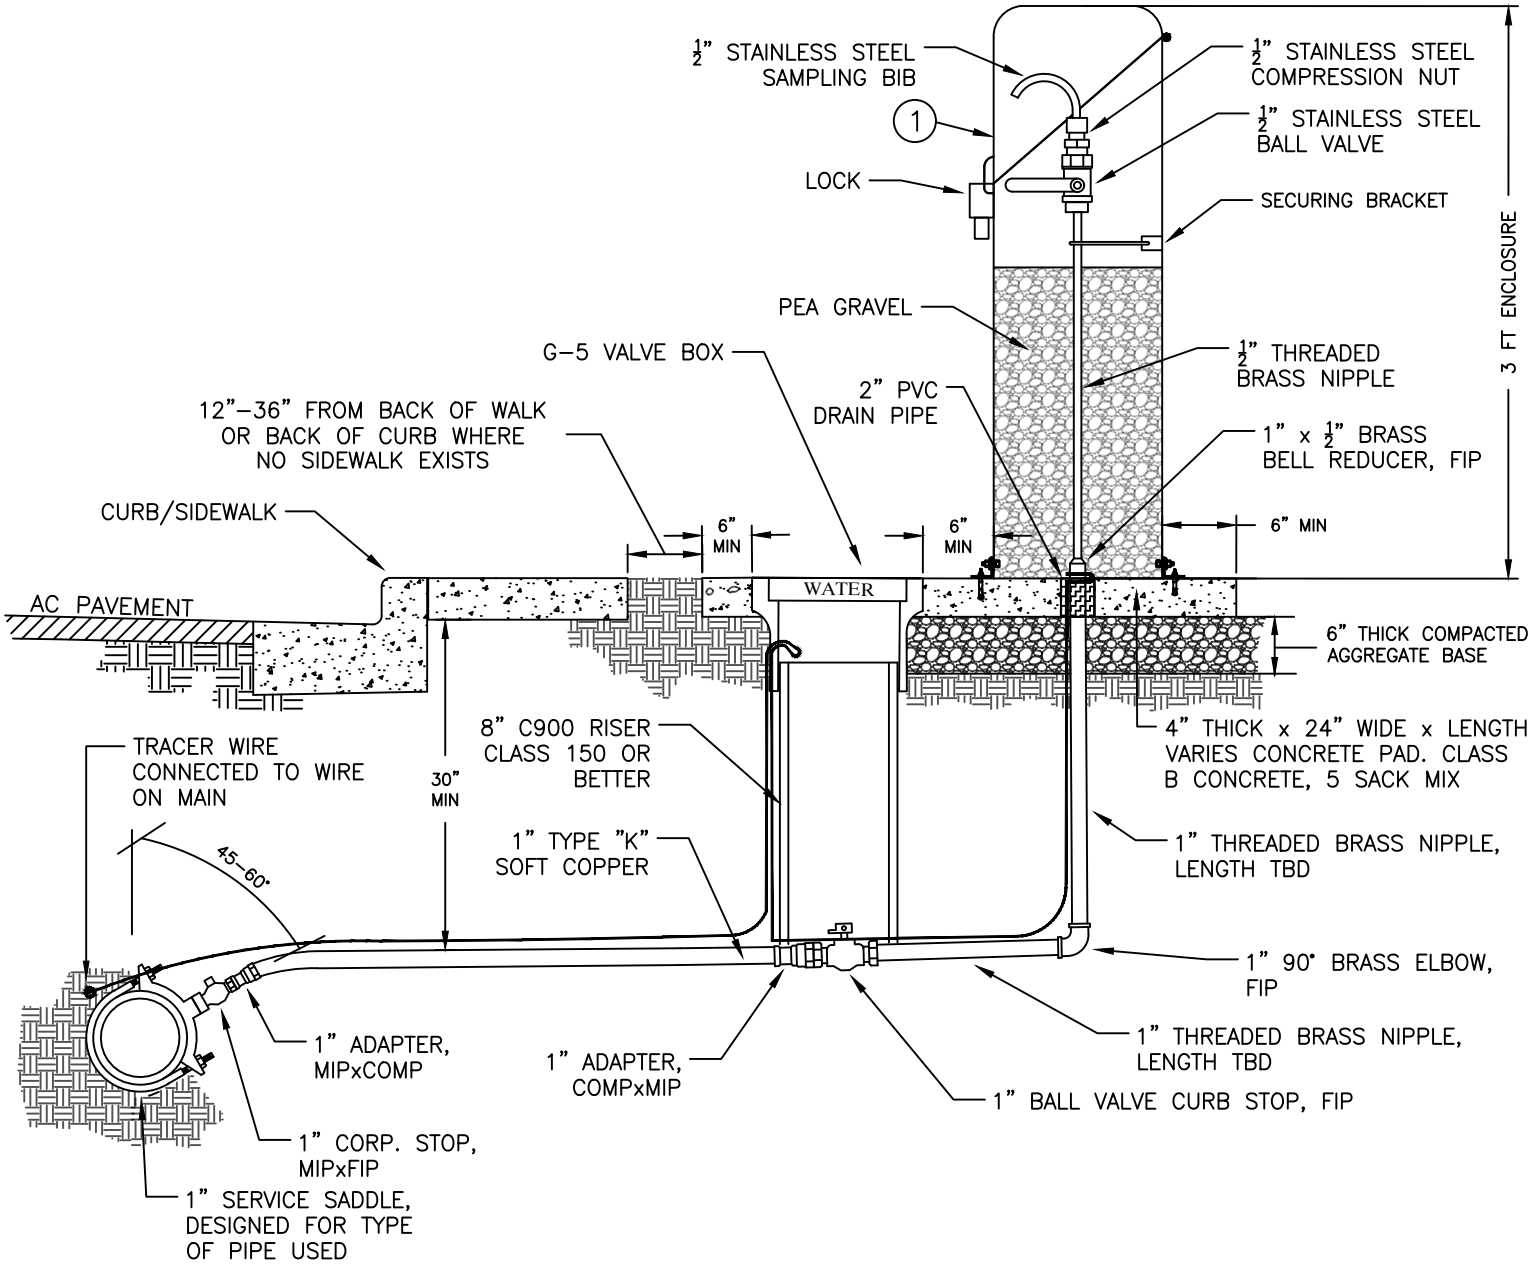

NOTES:

1. STATION SHALL BE ENCLOSED IN A LOCKABLE, NON-REMOVABLE BOX WITH HINGED OPENINGS, COATED HUNTER GREEN (PIPELINE PRODUCTS WTSQ-658SS OR APPROVED EQUAL).
2. 1" SUPPLY REDUCED TO ½" AT 6" ABOVE GRADE.
3. ALL BURIED METAL SHALL BE WRAPPED WITH 10 MIL POLY TAPE.
4. PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.
5. VALVE BOX AND RISER SHALL BE SET PLUMB AND CENTERED OVER WATER VALVE NUT.
6. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.

FAIR OAKS WATER DISTRICT
10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM

FAIR OAKS WATER DISTRICT

SAMPLE STATION

APPROVED:	B. CHETCUTI
DRAWN BY:	D. LEE
DRAWING:	STD-14
REVISED:	JUNE 2026
SCALE:	NONE

STANDARD SPECIFICATIONS

STANDARD DRAWING 14