


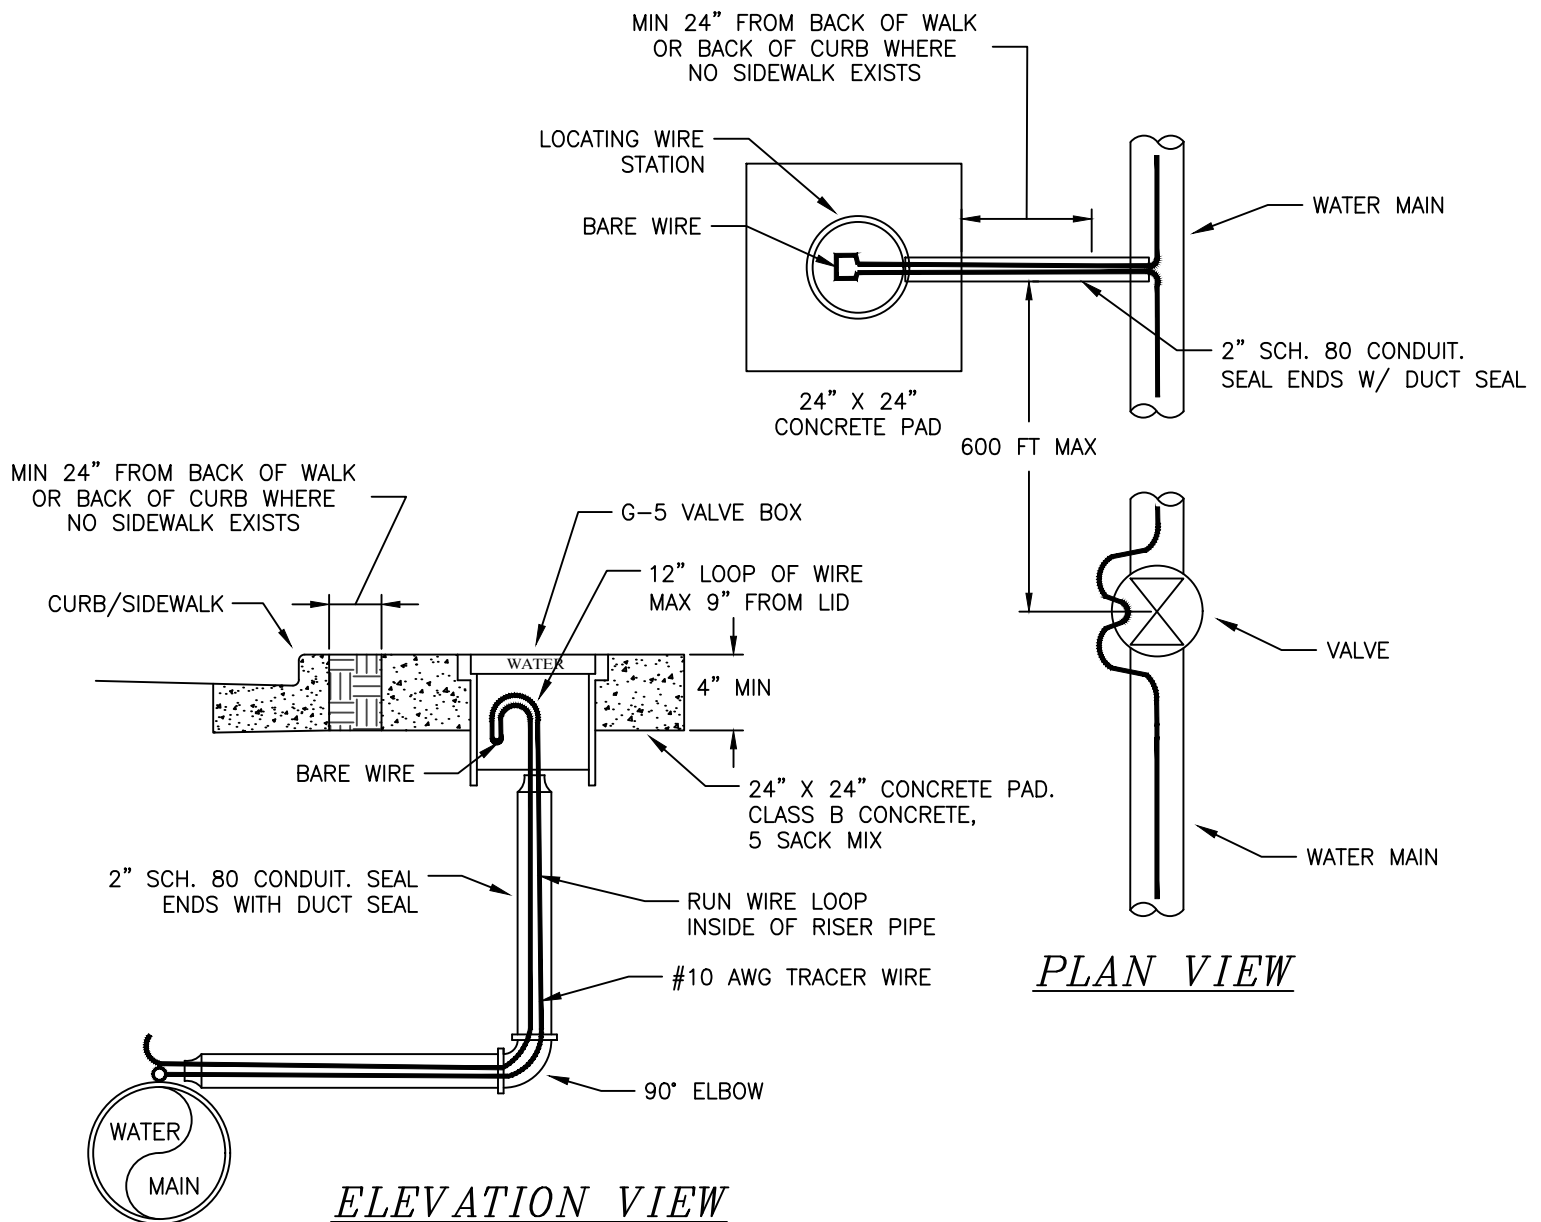

NOTES:

1. INSTALL A TRACER WIRE STATION WHEN THE WIRE RUN EXCEEDS 600 FEET BETWEEN ACCESS POINTS.
2. NUMBER 10 AWG PVC COATED SOFT-DRAWN COPPER WIRE SHALL BE USED.
3. ROUTE THE WIRE TO TRACER VALVE BOX, ENSURING A 12" BARE WIRE LOOP INSIDE THE BOX. TRACER WIRE SHALL BE INSTALLED CONTINUOUSLY WITHOUT SPLICES, UNLESS REQUIRED.
4. A CONTINUITY TEST SHALL BE PERFORMED BY CONTRACTOR AT TIME OF FINAL ACCEPTANCE AND WITNESSED BY A FOWD AUTHORIZED REPRESENTATIVE.
5. REFER TO FOWD STD-5 FOR TRACER WIRE INSTALLATION AND SPLICE DETAILS.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

**TRACER WIRE
STATION**

STANDARD DRAWING 5-1

APPROVED:

B. CHETCUTI

DRAWN BY:

D. LEE

DRAWING:

STD-5-1

REVISED:

JUNE 2026

SCALE:

NONE

STANDARD SPECIFICATIONS