


BACKFLOW ASSEMBLY IS NOT SHOWN
FOR MAP CLARITY. SEE FOWD STD-12

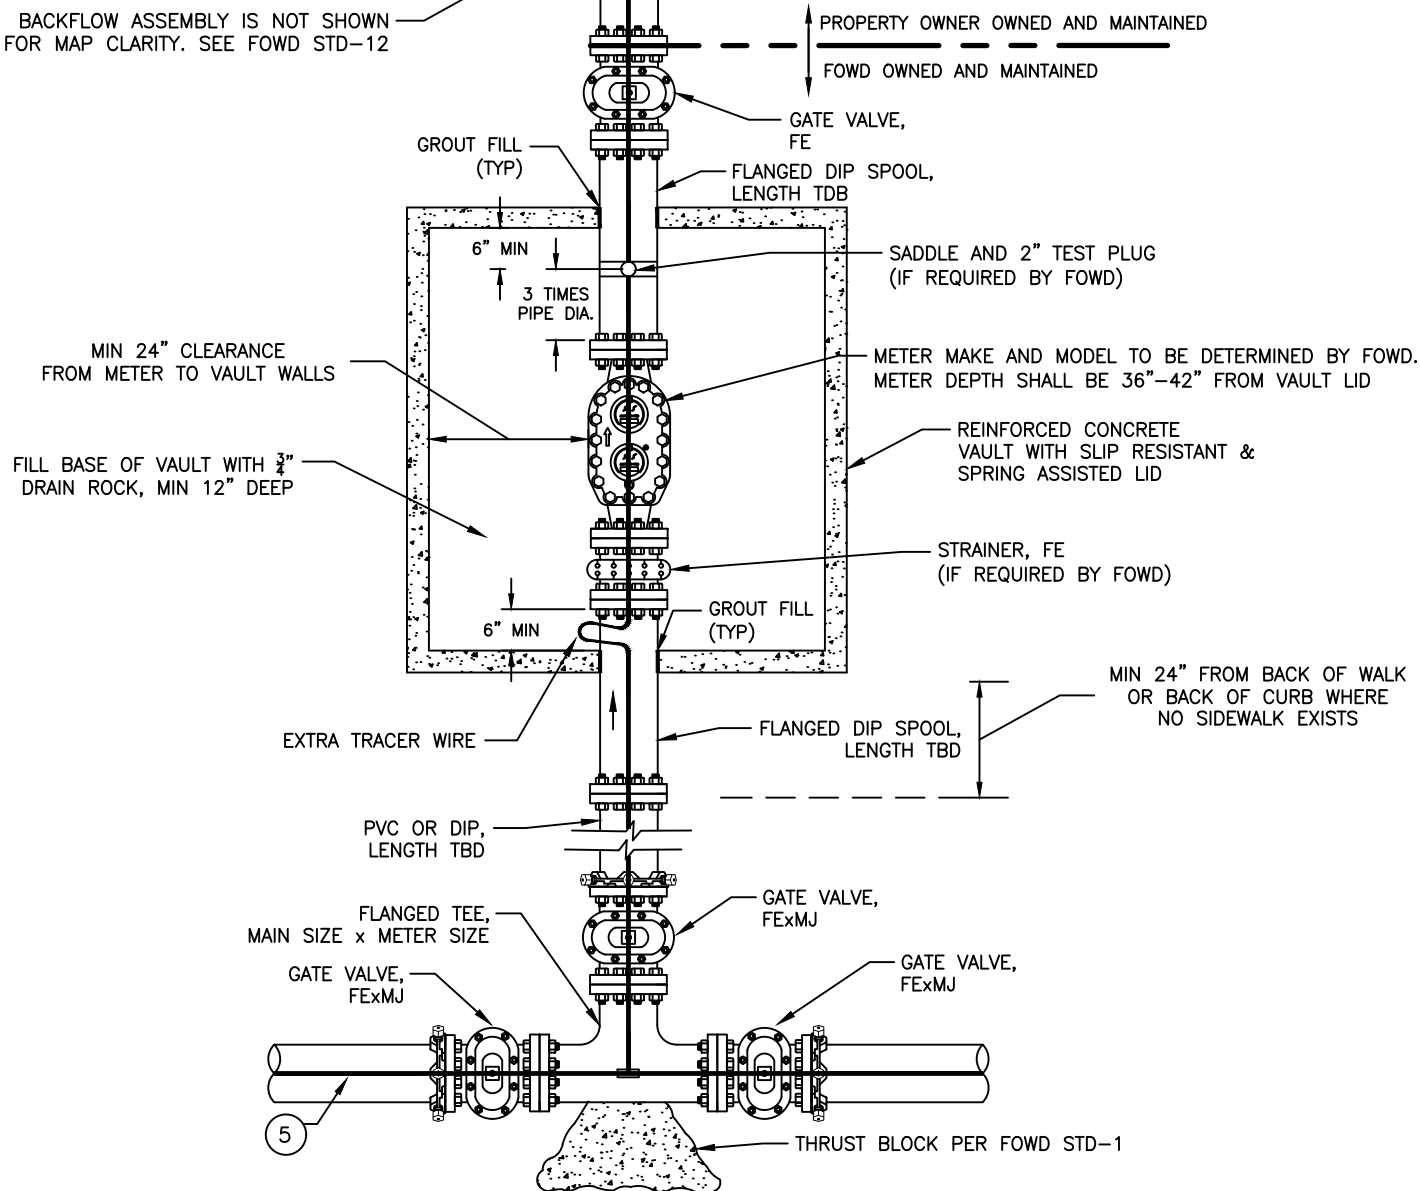

NOTES:

1. BYPASS PIPING IS REQUIRED FOR ALL SERVICES EXCEPT LOOPED SYSTEMS OR IRRIGATION SERVICES, SEE FOWD STD-13-1 FOR REFERENCE.
2. MINIMUM VAULT SIZE SHALL BE 5 FT WIDE x 6 FT LONG x 4 FT DEEP. VAULT AND LID TO BE APPROVED BY FOWD.
3. VALVES TO BE INSTALLED WITH 8" C900 RISER PIPE (CLASS 150 OR BETTER) AND TRAFFIC-RATED G-5 VALVE BOX WITH LID MARKED "WATER". VALVE BOX AND RISER SHALL BE SET PLUMB AND CENTERED OVER WATER VALVE NUT.
4. VALVE INSTALLED WITHIN COUNTY ROADWAYS SHALL HAVE 6"x6" THICK CIRCULAR CONCRETE COLLAR UNDER AC PER SACRAMENTO COUNTY STANDARDS.
- ⑤ PLACE #10 AWG TRACER WIRE TAPED TO PIPE AND CONNECTED TO TRACER WIRE ON MAIN PER FOWD STD-5.
6. ALL BURIED METAL SHALL BE ENCASED WITH 8 MIL POLY WRAP. WRAP WITH 2 LAYERS AT SLAB PENETRATIONS.
7. ALL MECHANICAL JOINT (MJ) CONNECTIONS SHALL BE COUPLED WITH MEGALUGS.
8. MIN. 10 FT HORIZONTAL SEPARATION FROM SEWER AND 4 FT FROM ANY OTHER UTILITIES IS REQUIRED.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

3" AND LARGER METER WITHOUT BYPASS

STANDARD DRAWING 13

APPROVED: B. CHETCUTI

DRAWN BY: D. LEE

DRAWING: STD-13

REVISED: JUNE 2026

SCALE: NONE

STANDARD SPECIFICATIONS